



- ☑ Model 962 – Recess-Mounted **Bradex**[®]
- ☑ Model 962-11 – Surface-Mounted **Bradex**[®]
- ☑ Meets relevant sections of the CPSIA to the extent possible.
- ☑ Meets or exceeds ASTM F2285 Safety Specification for Commercial Changing Stations.

Product Materials

BODY: bacterial-resistant polyethylene with brushed 20 gauge stainless steel exterior. Rated to support static load of 250 lbs, tested to 390 lbs. Pneumatic gas shock mechanism to ensure smooth, safe open and close motions. Black corner guards for added protection.

MOLDED DUAL LINER DISPENSER: holds approx. 50 per dispenser (liners sold separately).

SAFETY BELT: with cam-buckle, adjustable with one hand.


⚠ WARNING: Be sure to use reinforced backing behind wall where mounting screws or anchoring devices are installed to ensure adequate support for the baby changing station. All anchoring devices (supplied by installer) must be appropriate for specific wall construction. Severe personal injury and/or property damage may result from improper mounting.

ADA Compliant

- ☑ Consult local and national accessibility codes for proper installation guidelines.
- ☑ Conformity and compliance to local and national codes is the responsibility of the installer.

Service Parts Available

Part Number	Description
P11-021	Liners (100% bio-degradable), Case of 500
P15-491	Replacement Strap

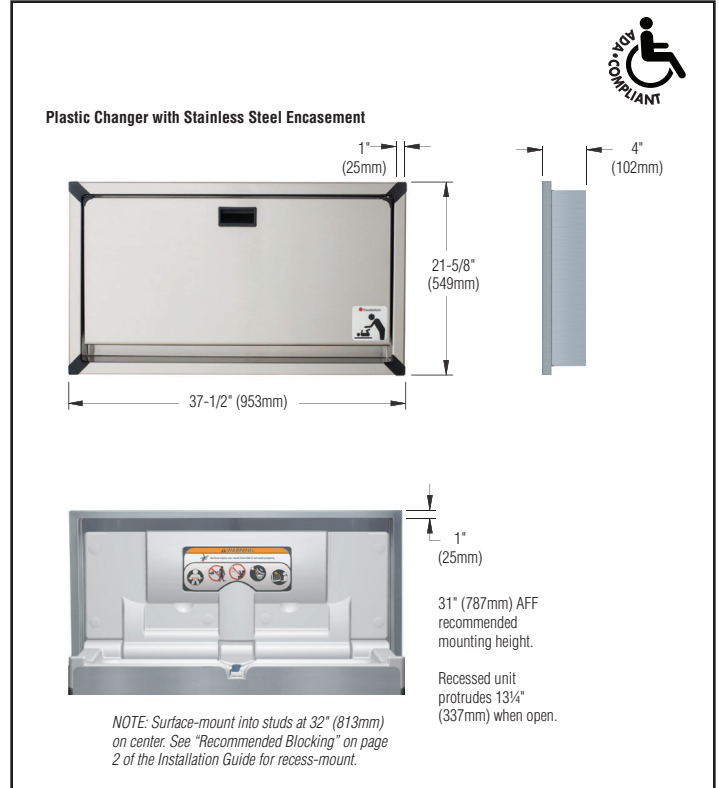

Orders composed of products indicated as **Bradex**[®] will be available to ship in three days after receipt of order at the factory. There is no pricing penalty for this service from Bradley.

Page 1 of 1 9/18/2017
This information is subject to change without notice.
Bradley_BabyChanger_962_11

© 2017 Bradley
P.O. Box 309, Menomonee Falls, WI 53052-0309
800 BRADLEY (800 272 3539) +1 262 251 6000
bradleycorp.com